
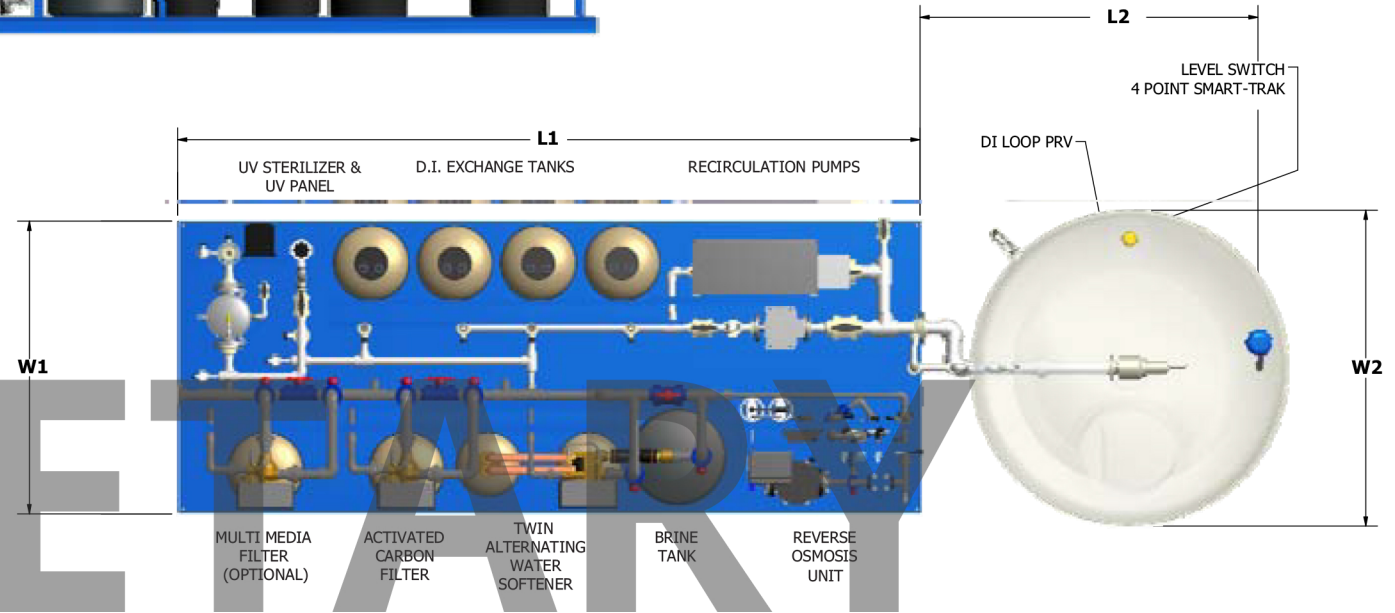
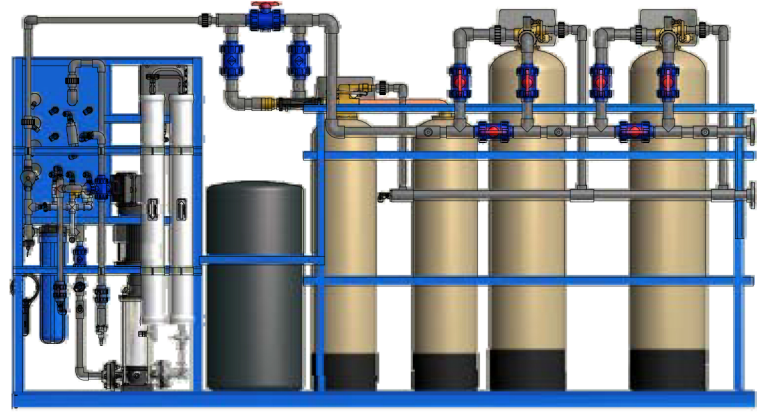



CONNECTION SCHEDULE						
ITEM	DESCRIPTION	LOCATION	MAX FLOW	SIZE	CONNECTION	MATERIAL
A	RAW WATER INLET	HIGH PURITY SKID	GPM	in	150# FLG. RF	PVC SCH 80
B	CONCENTRATE/ WASTE OUTLET	HIGH PURITY SKID	GPM	in	150# FLG. RF	PVC SCH 80
C	HIGH PURITY LOOP FEED	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP
D	HIGH PURITY LOOP RETURN	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP
E	TANK EMERGENCY OVERFLOW	HIGH PURITY SKID	GPM	in	150# FLG. RF	PP

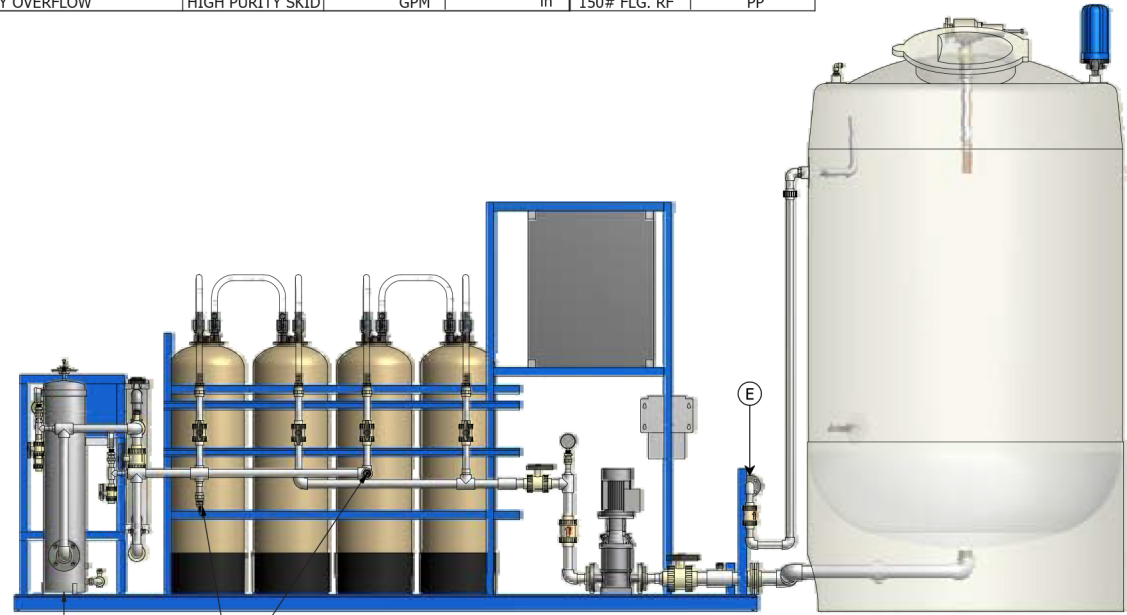

316SS, 0.2 MICRON FINAL FILTER
RESISTIVITY CELLS

460V/60HZ/3PH MOTOR STARTER PANEL

TUBE TO RO PERMEATE CONNECTION
O.2 MICRON AIR VENT

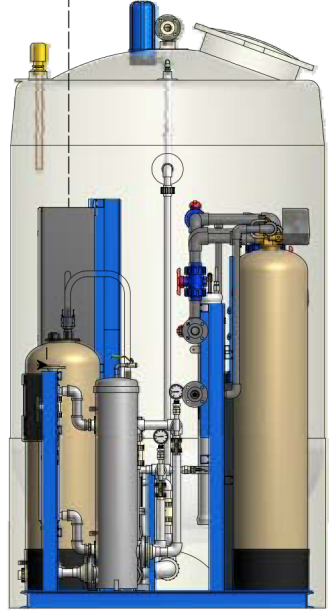

5-279-01

REVISIONS			
NO.	DATE	BY	REMARKS

MARLO
INCORPORATED

HIGH PURITY WATER TREATMENT SKID GENERAL ARRANGEMENT DRAWING			
FRAC.	DEC.	FILE ID.	
DRN.	Anthony	SCALE	SHEET 1 OF 1
APP'D.	SPL	DRAWING NO.	REV.
DATE	9/28/2010		